



Data sheet 7Y00.J7

Universal check valve F/F with brass shutter for high pressure

Contents

DESCRIPTION	3
PERFORMANCE	3
COMPONENTS AND MATERIALS	3
REGULATIONS	4
DIMENSIONS	4
CHART	5
ASSEMBLY INSTRUCTIONS	5
MAINTENANCE	6

7Y00.J7**Universal check valve F/F with
brass shutter for high pressure**

DESCRIPTION

7Y00.J7 is a universal check valve F/F with shutter for high pressure.

Universal check valves are unidirectional operating devices that allow to avoid the return of the fluid under pressure. They are used in plants with sanitary water, water raising, heating, in the thermal power stations, in heat generators (wall boilers, heat pumps...) and others.

The internal hydraulic seal is carried out by means of the forces exerted by a spring and the liquid pressure over a gasket which also implements the seal at minimum back pressures.

In addition to this, the strength of the spring allows the valve to have universal characteristic with regard to installation position.

PERFORMANCE

Working temperature (occasional)	- 20°C ; + 110 °C
Working temperature (no freeze)	0 °C ; + 95 °C
Opening pressure	0.02 bar
Max. working pressure	16 bar (G 1/2-G1) 10 bar (G 1 1/4-G2)
Compatible fluids	thermal water, glycol solutions (max 30%), sanitary water.
Tests and inspections	EN12166-1 §A.3.

COMPONENTS AND MATERIALS

COMPONENTS	MATERIALS
Body	CW617N EN 12165
Gaskets	ELASTOMER
Spring	STAINLESS STEEL AISI 302
Cut off valve	CW614N EN 12165 (G 1/2") CW617N EN 12165 (G 3/4"-G 2")

REGULATIONS


- UN EN ISO 228-1

Threads complies with UNI EN ISO 228-1:2003 law: "Piping thread for coupling not with tightness on the thread"

- D.M. 174 (06/04/2004)


Raw materials used are of high quality and comply with the Ministerial Decree N°174 dated 06/04/2004 concerning the materials and the items used in fixed installations for water collection, treatment and supply.

DIMENSIONS

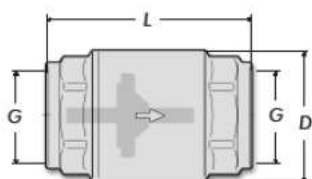

CODE	P (bar)	G	D	L	Weight (g)
7Y00J7H040400A	50	G 1/2	32	58	162
7Y00J7H050500A	50	G 3/4	39	65	250
7Y00J7H101000A	50	G 1	47	75	362
7Y00J7H121200A	35	G 1 1/4	60	80	594
7Y00J7H141400A	35	G 1 1/2	67	85	708
7Y00J7H202000A	35	G 2	83	94	1149

CHART

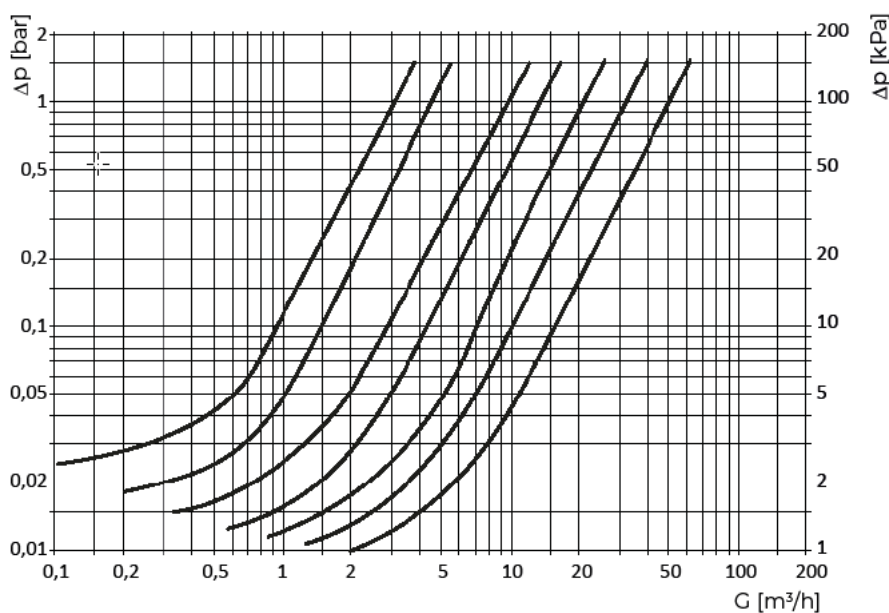

SIZE	G [m³/h] con Dp=1 bar	G [m³/h] con Dp=1,5 bar
G 1/2	4.4	5.5
G 3/4	9.8	14
G 1	13	17
G 1 1/4	21	26
G 1 1/2	31.5	40
G 2	50	62

ASSEMBLY INSTRUCTIONS

The universal check valves can be installed in any position respecting the direction flow indicated by the arrow on the valve body.

The assembly on the pipes is done through threads, using normal hydraulic practices.

We recommend installing the check valve by combining it with an upstream shut-off valve, easily accessible

Before installation, it is recommended to flush the pipe to remove residues installation.

MAINTENANCE

Check the valve periodically, according to the frequency of use and the working conditions:

- 1) at each pressure drop in the upstream water supply network or flow stop, check the closure of the valve to prevent backflow upstream;
- 2) if there are leaks at the seal, these can be caused by deposits or foreign bodies. In this case it is necessary to disassemble the valve from the system and clean carefully the gasket removing with compressed air or mechanical action all the impurities. If necessary, replace the valve.



GENERAL FITTINGS SPA
Via Golgi 73/75, 25064 Gussago (BS) - ITALY
te. +39 030 3739017
www.generalfittings.it